




**South Dublin
County Council**

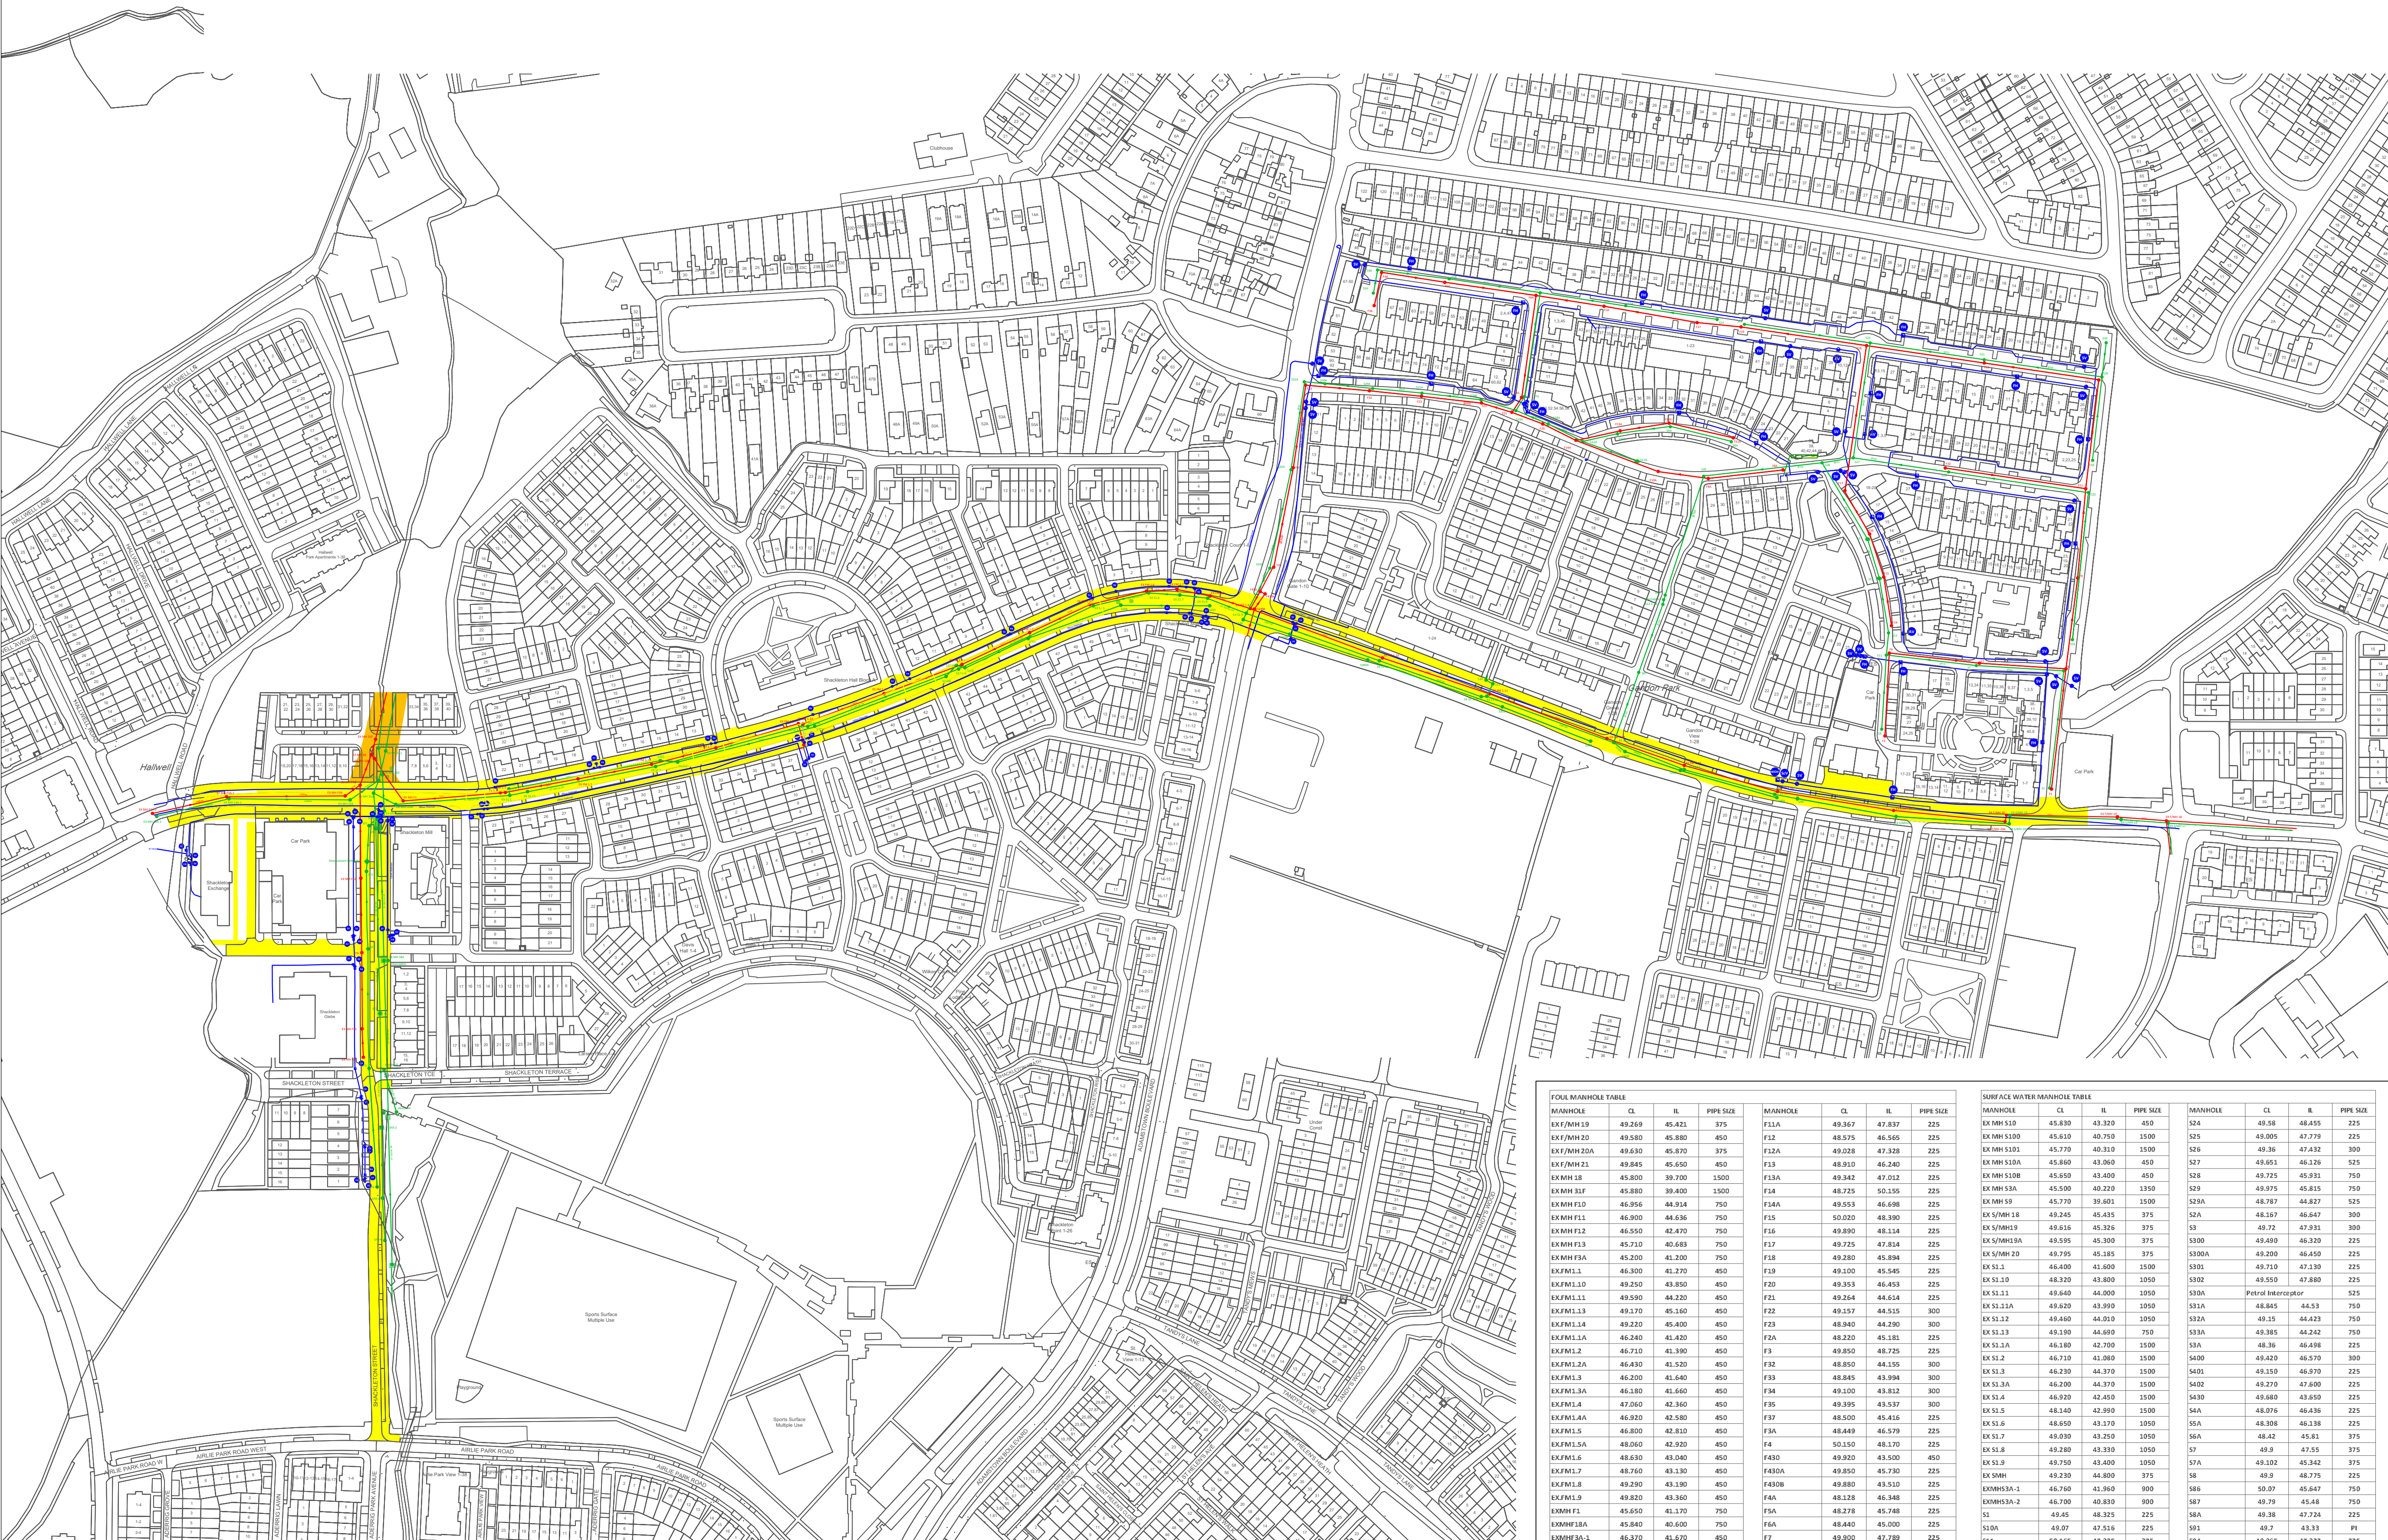

Director: **Eoin Burke**

Senior Engineer: **John Hegarty**

The diagram illustrates a sewer system layout with the following components and connections:

- Foul Sewer:** Represented by a red line at the top.
- Surface Water Sewer:** Represented by a green line below the Foul Sewer.
- Watermain:** Represented by a blue line below the Surface Water Sewer.
- Fire Hydrant:** Indicated by a blue circle with 'FH' and a blue square with a white 'N'.
- Air Valve:** Indicated by a blue circle with 'AV' and a blue circle with a white 'S'.
- Foul Water Under 225mm:** Indicated by a grey circle.
- Surface Water Under 225mm:** Indicated by a grey circle.
- Site Boundary:** Represented by a red line at the bottom.

Connections are shown as follows:

- The Foul Sewer connects to the Fire Hydrant (FH) and the Air Valve (AV).
- The Surface Water Sewer connects to the Fire Hydrant (FH) and the Air Valve (AV).
- The Watermain connects to the Fire Hydrant (FH) and the Air Valve (AV).
- The Foul Water Under 225mm connects to the Foul Sewer.
- The Surface Water Under 225mm connects to the Surface Water Sewer.

Revision	Description	Date

Notes:

- This drawing does not constitute a recommendation to have an estate taken in charge.
- This drawing refers to the taking into charge of the roads and services as indicated in colour.
- All sewers are 225mm dia. unless otherwise indicated.
- Scaled dimensions not to be used.
- Boundary of roads as on attached road schedule.
- Secondary treatments to roads taken in charge i.e. walls and/or railings are not included in, and are not part of the taking in charge procedure.

Drawing Title:	
Taking in Charge Scheme	
Drawn by:	O.S. Reference:
PL	3260- A, B, 8, 9

OCSC	1:2000
Checked:	Date: 07/11/2025

MANHOLE TABLE				SURFACE WATER MANHOLE TABLE												
MANHOLE	CL	IL	PIPE SIZE	MANHOLE	CL	IL	PIPE SIZE	MANHOLE	CL	IL	PIPE SIZE					
EKF/MH19	49.269	45.421	375	F11A	49.367	47.837	225	IX/MH150	45.830	43.320	450	S24	49.58	48.455	225	
EKF/MH20	49.580	45.880	450	F12	48.575	46.566	225	IX/MH150	45.610	43.750	1500	S25	49.005	47.779	225	
EKF/MH20A	49.630	45.870	375	F12A	49.028	47.328	225	IX/MH1501	45.770	43.310	1500	S26	49.36	47.432	300	
EKF/MH21	49.845	45.650	450	F13	48.010	46.240	225	IX/MH150A	45.860	43.060	450	S27	49.651	48.126	225	
EKF/MH18	45.800	39.700	1500	F13A	49.342	47.012	225	IX/MH150B	45.560	43.400	450	S28	49.725	49.931	750	
EKF/MH18	45.880	39.400	1500	F13B	50.020	47.380	225	IX/MH150A	45.590	42.710	1500	S29	49.975	49.845	750	
EKF/MH10	46.956	44.934	750	F14A	49.553	46.698	225	IX/MH151	45.770	43.060	1500	S30A	49.787	48.817	375	
EKF/MH12	46.800	44.636	750	F15	49.890	48.114	225	IX/MH18	49.245	45.435	375	S2A	49.617	46.647	300	
EKF/MH12	46.550	42.470	750	F16	49.725	48.114	225	IX/MH19	49.616	45.326	375	S3	49.72	47.931	300	
EKF/MH13	45.710	40.668	750	F17	49.725	47.814	225	IX/MH150A	45.955	45.300	375	S300	49.490	46.320	225	
EKF/MH13A	45.200	42.200	750	F18	49.280	48.894	225	IX/MH120	49.795	45.185	375	S300A	49.200	46.450	225	
EKF/M1.1	46.300	41.270	450	F19	49.100	45.545	225	IX/S1.1	46.400	41.600	1500	S301	49.710	47.330	225	
EKF/M1.10	49.250	43.850	450	F20	49.353	46.453	225	IX/S1.10	48.120	43.820	1050	S302	49.550	47.880	225	
EKF/M1.11	49.590	44.220	420	F21	49.264	46.654	225	IX/S1.11	49.640	46.000	1050	S30A	Petrol Interceptor			525
EKF/M1.13	49.770	45.160	450	F22	49.157	46.515	300	IX/S1.12A	49.620	43.990	1050	S31A	48.845	46.53	750	
EKF/M1.14	49.220	45.400	450	F23	48.840	46.290	300	IX/S1.12	49.640	44.010	1050	S31A	49.15	46.423	750	
EKF/M1.1A	46.240	41.420	450	F2A	48.220	45.181	225	IX/S1.13	49.930	44.590	750	S32A	49.395	44.242	750	
EKF/M1.2	46.710	41.390	450	F3	48.950	48.725	225	IX/S1.13A	46.180	42.700	1500	S3A	48.36	46.498	225	
EKF/M1.2A	46.430	41.520	450	F3	48.850	44.195	300	IX/S1.2	46.710	41.080	1500	S400	49.420	46.970	300	
EKF/M1.3	46.200	41.640	450	F3A	48.845	43.994	300	IX/S1.3	46.230	44.370	1500	S401	49.150	46.970	225	
EKF/M1.3A	46.800	41.640	450	F3A	49.100	43.812	300	IX/S1.3A	46.200	44.370	1500	S402	49.270	47.800	225	
EKF/M1.4	47.060	42.360	450	F3B	49.395	43.537	300	IX/S1.3A	46.920	42.450	1500	S430	49.680	43.650	225	
EKF/M1.4A	46.820	42.880	450	F3B	48.500	45.416	225	IX/S1.5	46.140	42.990	1500	S4A	48.076	46.436	225	
EKF/M1.5	46.800	42.510	450	F3A	48.449	46.579	225	IX/S1.6	48.650	43.370	1050	S5A	48.308	46.138	225	
EKF/M1.5A	48.060	42.920	450	F4	50.150	48.170	225	IX/S1.6	49.030	43.350	1050	S6A	48.81	46.432	225	
EKF/M1.6	46.630	40.040	450	F40	49.020	43.500	450	IX/S1.6	49.880	43.330	1050	S7	49	47.55	375	
EKF/M1.7	48.760	43.130	450	F40A	49.850	45.730	225	IX/S1.9	49.750	43.400	1950	S7A	49.102	45.342	375	
EKF/M1.8	49.290	43.190	450	F40B	49.880	43.510	225	IX/S0A	49.230	44.800	375	S8	49.9	48.775	225	
EKF/M1.9	49.620	43.360	450	F4A	48.128	46.348	225	EKM/MSA-1	46.760	41.960	900	S86	50.07	45.847	750	
EKM/F1	45.650	41.170	750	F5A	48.278	45.748	225	EKM/MSA-2	46.700	40.830	900	S87	49.79	45.484	750	
EKM/F13A	46.430	40.600	750	F6A	48.640	45.000	225	S1	49.45	48.325	225	S8A	49.78	47.724	225	
EKM/F13A	46.370	41.670	450	F7	49.050	47.780	225	S10A	49.07	47.515	225	S91	49.7	43.33	PI	
EKM/F13A-2	46.280	40.510	450	F7A	49.168	46.768	225	S11	50.165	47.325	375	S9A	49.365	47.322	225	
F1.1	49.450	48.325	225	F8	49.685	47.475	225	S12	49.773	48.352	225	S91	49.64	47.135	450	
F1.11	46.300	41.220	450	F8A	49.836	48.407	225	S12	50.144	47.711	375	S91A	49.154	46.1	450	
F1.10	49.370	47.945	225	F9	49.335	47.180	225	S12A	49.958	47.224	300	S92A	48.054	44.524	1500	
F10A	49.803	47.435	225	F9A	49.954	47.856	225	S13	50.02	47.136	375	S93A	48.866	46.844	1500	
F11	48.990	46.900	225					S17	49.480	46.961	450	S94	49.16	46.841	1500	
								S18	48.875	47.75	225	S91	44.05	43.015	450	
								S18A	49.339	46.799	375	S93	46.273	43.310	450	
								S19	48.4	47.275	225	S94	46.94	44.712	450	
								S19A	49.124	45.144	375	S95	47.72	45.746	225	
								S20	48.7	47.472	225	S96	46.768	47.435	225	
								S20A	48.4	46.937	300	S97	46.094	46.347	300	
								S21	49.248	45.188	375	S97A	47.417	44.869	1500	
								S21A	48.91	46.62	375	S9A	49.97	45.295	1350	
								S22A	48.98	45.01	525	S90	49.370	44.920	375	
								S22	49.1	47.975	225	S9	49.830	45.100	300	
								S23	49.27	46.358	450	S91	49.950	45.020	375	

Includes Taite Eireann data reproduced under Taite Eireann Licence number CYAL50380380 SouthDublinCountyCouncil.

Unauthorised reproduction infringes Taite Eireann and Government of Ireland copyright.

© Taite Eireann - Surveying.

Taking in Charge Note:

South Dublin County Council will maintain all roads, footpaths, public lighting and storm water systems including SUDS related infrastructure as well as all trees, Class 1 open space grass areas and playgrounds and furniture approved as part of the planning permission.

South Dublin County Council will not maintain services deemed to be the responsibility of Uisce Éireann and other utility providers. Allocated parking bays, ornamental planting schemes, smaller grassed areas and verges and additional features not approved at the planning stage unless otherwise agreed are the responsibility of the residents, residents association or designated management company.

Includes Tailte Éireann data reproduced under Tailte Éireann Licence number CYAL50380380 SouthDublinCountyCouncil.
Unauthorised reproduction infringes Tailte Éireann and Government of Ireland copyright.
© Tailte Éireann - Surveying.